
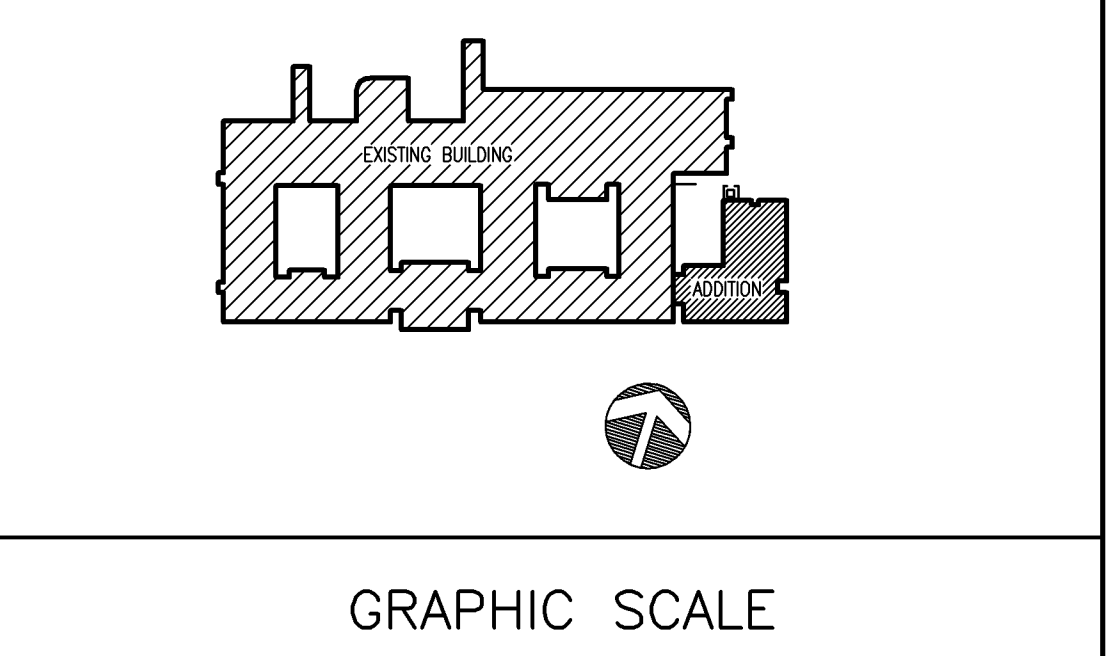


- ### KEYED NOTES
1. PROVIDE (2) 1-1/4" C. FROM FLOOR BOX TO ABOVE ACCESSIBLE CEILING FOR COMMUNICATIONS CABLING.
 2. COORDINATE LOCATION OF FIRE ALARM POWER SUPPLY WITH SYSTEM INSTALLER.
 3. PROVIDE DISTRIBUTION COUPLERS AND SPLITTERS ON WALL IN A/V STUDIO TO INTERFACE NEW COAXIAL BACKBONE CABLE AND HORIZONTAL DROPS FOR NEW ADDITION. MOUNT ON FIRE-RETARDANT PLYWOOD BACKBOARD. COORDINATE EXACT LOCATION WITH SCHOOL REPRESENTATIVE.

LEGEND

SYMBOL	DESCRIPTION
(S)	Smoke Detector
(SD)	Smoke Detector
(1T)	1-Tier Terminal
(2D)	2-Tier Drop
(3D)	3-Tier Drop
(4D)	4-Tier Drop
(1D)	1-Tier Drop
(F)	Fire Alarm Pull Station
(H)	Hand Alarm
(V)	Voice Alarm
(W)	Warning Alarm
(P)	Power Alarm
(CT)	Communication Terminal
(DC)	Data Connector
(CM)	Communication Module
(SM)	Signal Module
(HP)	Hand Panel
(VP)	Voice Panel
(TV)	Telephone
(HV)	Handset
(AV)	Alarm

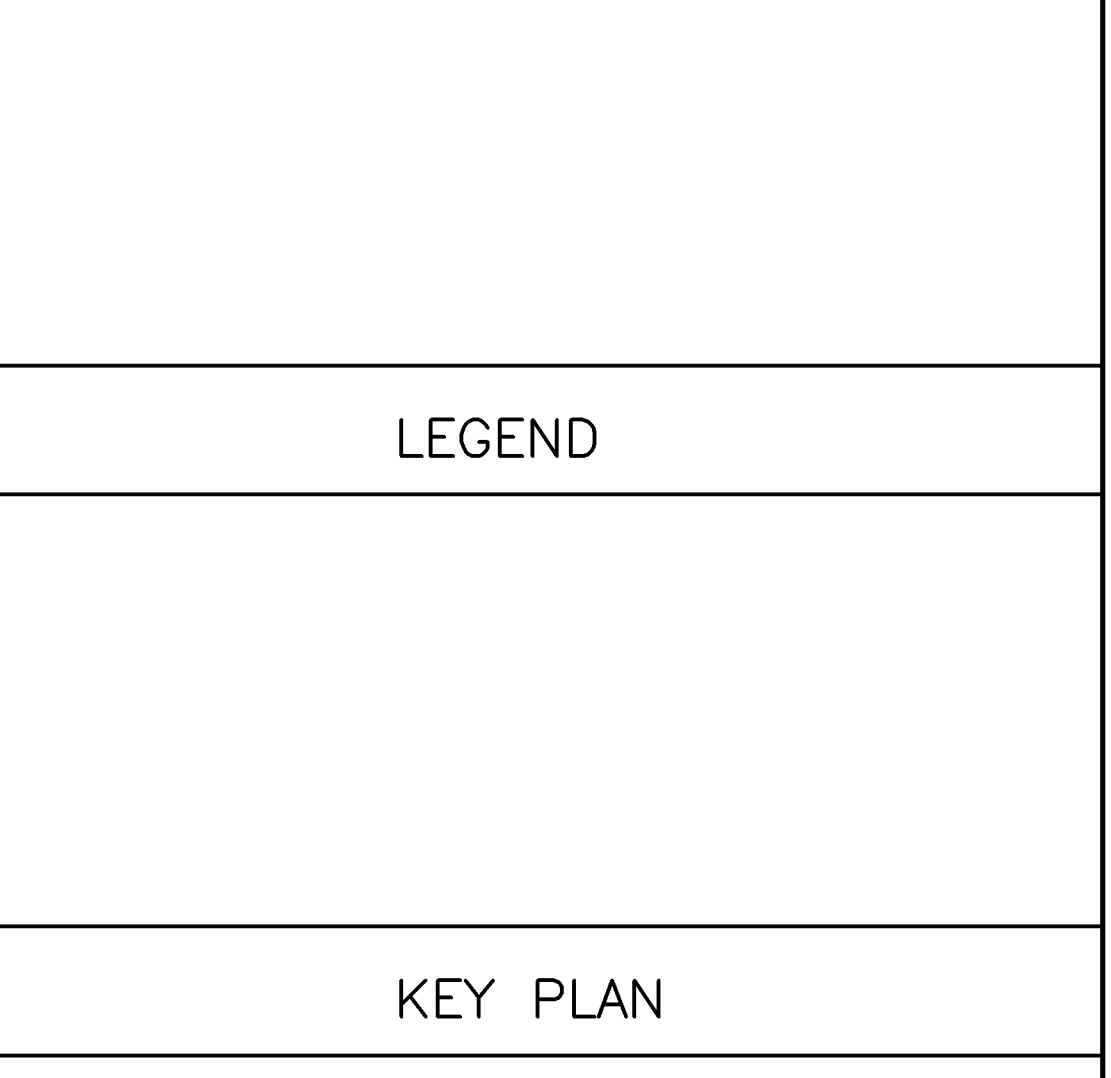

1 ELECTRICAL – FIRE ALARM & COMMUNICATION FLOOR PLAN
 E103 SCALE: 1/8" = 1'-0"

US ARMY CORPS OF ENGINEERS SAVANNAH

DATE	DESCRIPTION	BY

DESIGNED BY: IDM	DATE: 25 JAN 2010
DWN BY: IDM	SOLICITATION NO.: W912N-09-R-0018
SUBMITTED BY: BRNE/BS	CONTRACT NO.:
FILE NAME: BRNE/BS	CATEGORY CODE: 730-46-01
SIZE: 34x22	PLOT SCALE: 1/8"=1'-0"
	PLOT DATE:

U. S. ARMY ENGINEER DISTRICT
 CORPS OF ENGINEERS
 SAVANNAH DISTRICT

LS&P ASSOCIATES LTD.
 205 1/2 KING STREET
 CHARLESTON, SC 29401

ALBRITTON JUNIOR HIGH SCHOOL ADDITION FT BRAGG NORTH CAROLINA	<h2 style="margin: 0;">FIRE ALARM & COMMUNICATION PLAN</h2>
--	---

PLATE REFERENCE NUMBER E-103 SHEET 89
--